


NOTES:

1. WYES SHALL ONLY BE LOCATED WHERE INDICATED ON THE DRAWINGS.
2. ALL WATER PIPING 12" AND SMALLER SHALL BE DUCTILE IRON OR PVC.

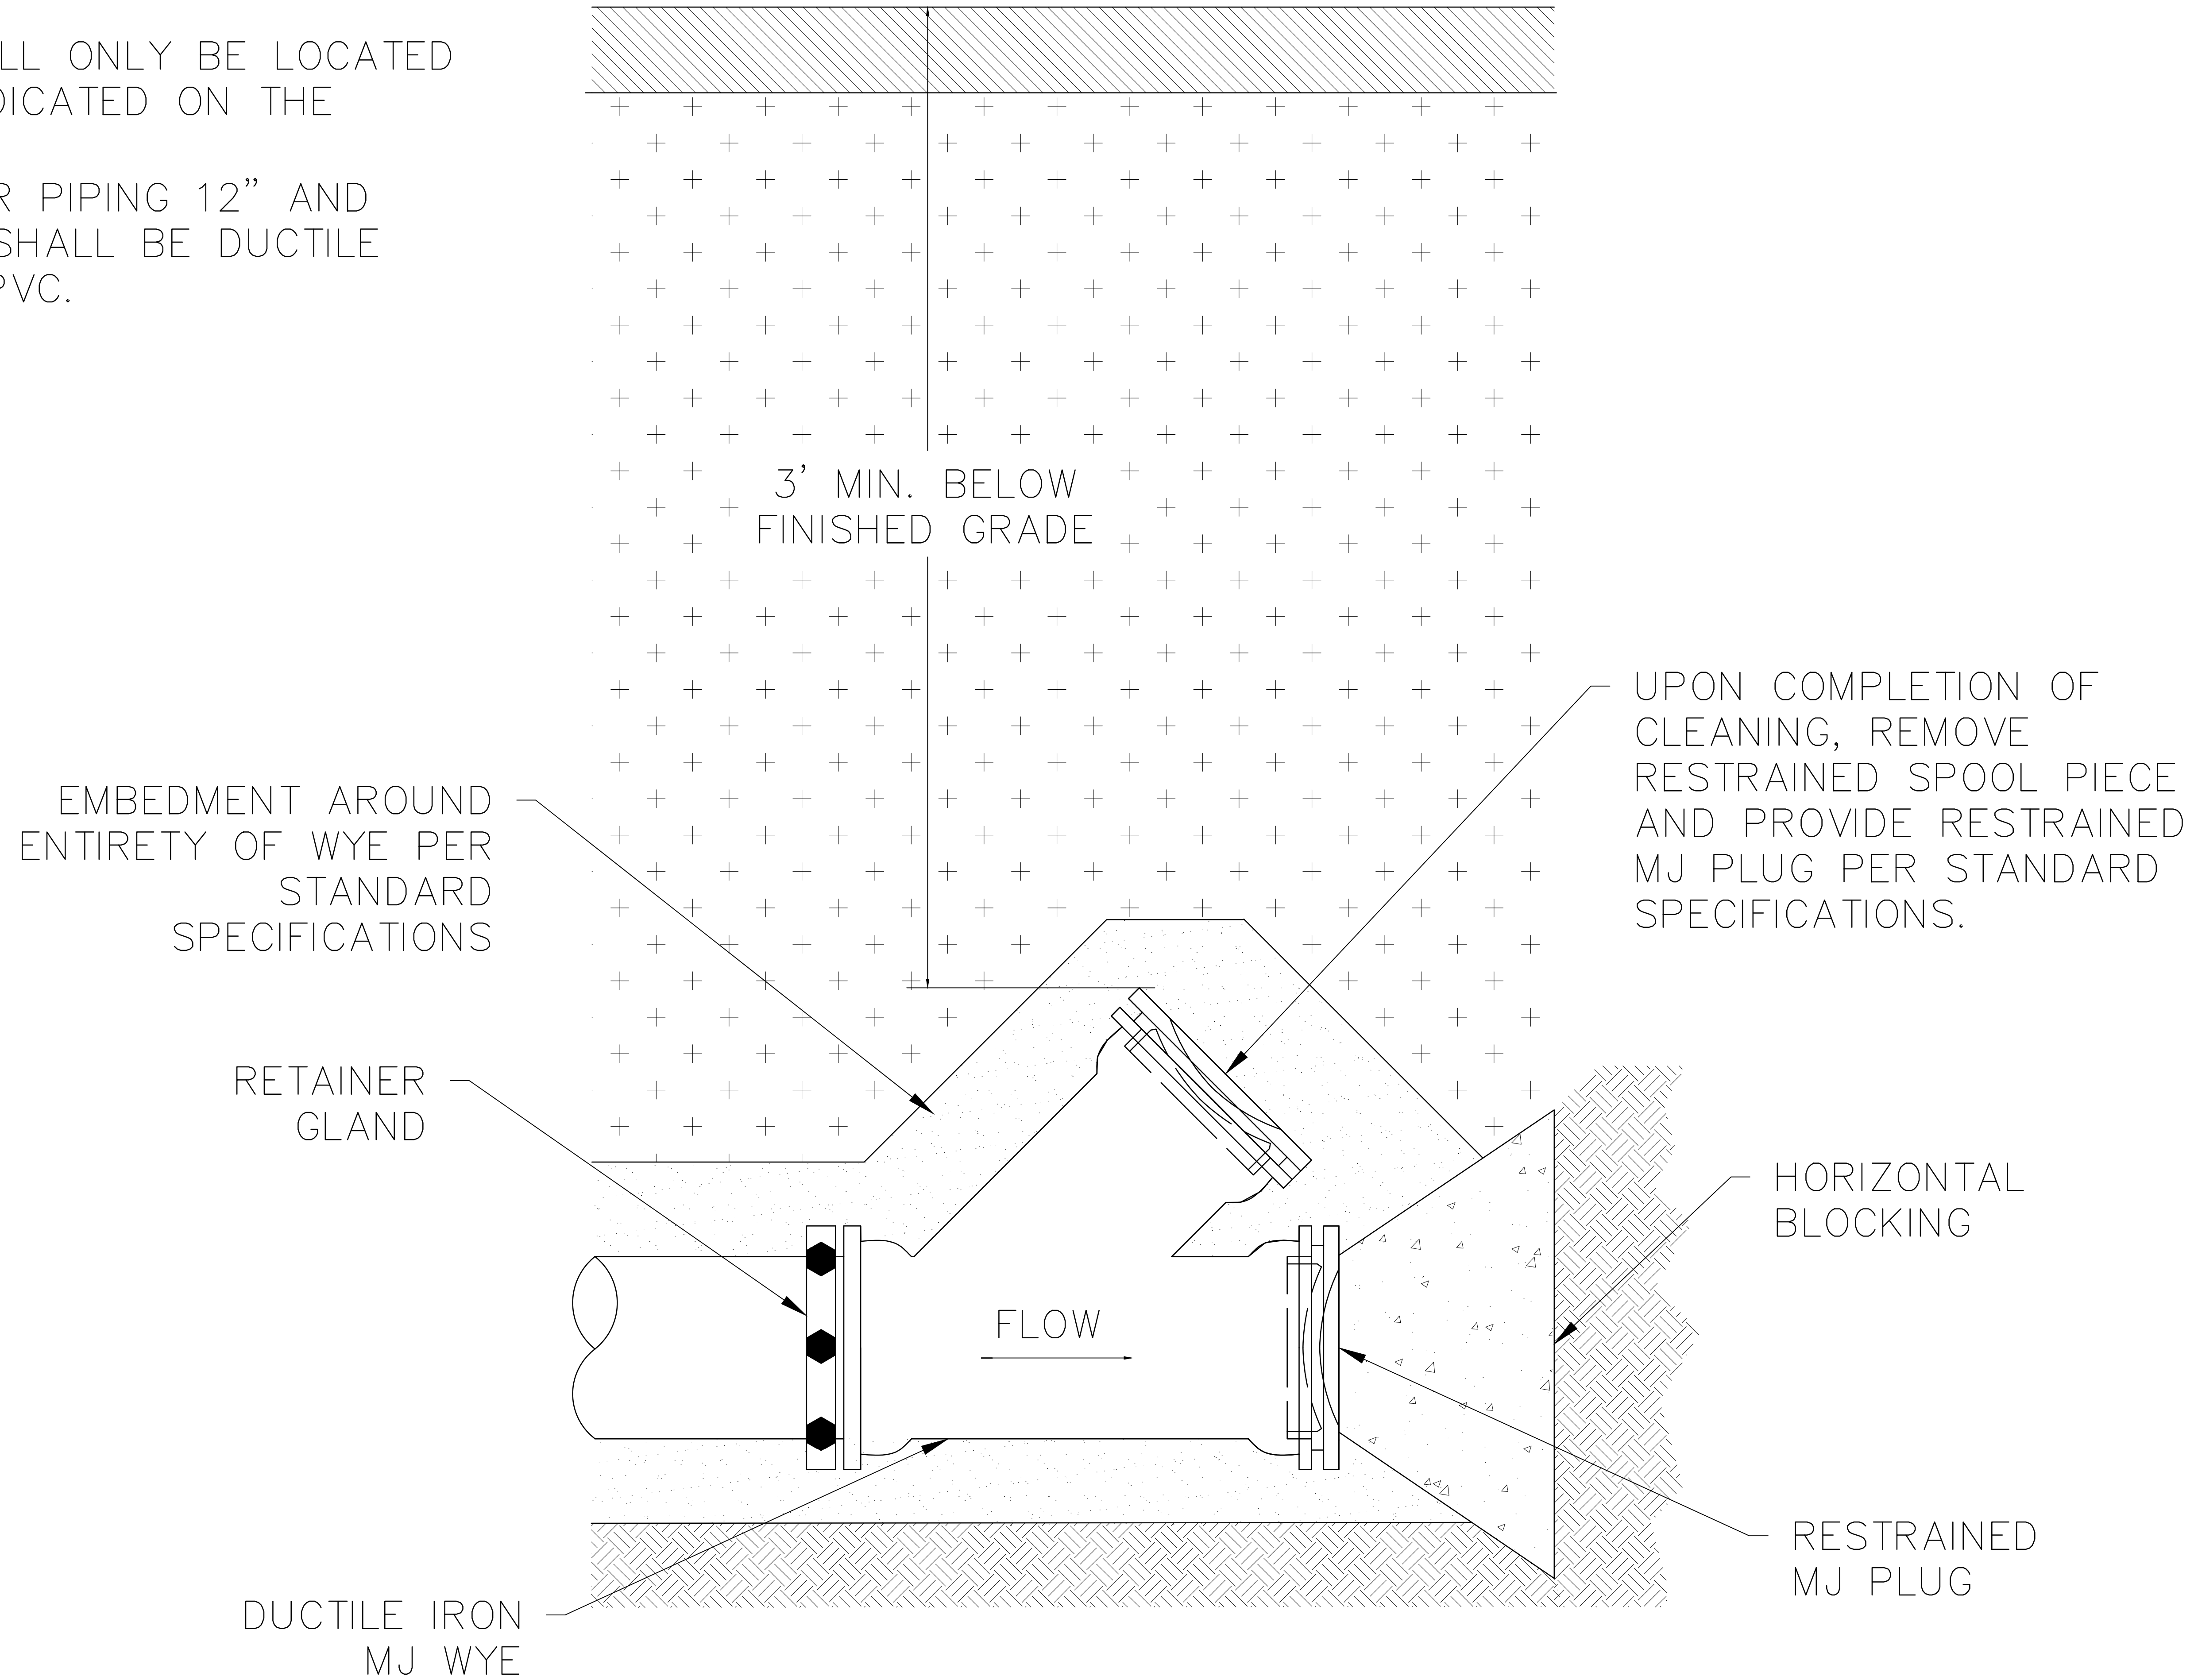

**CLEANING WYE ON NON-LOOPED WATER SERVICE**

N.T.S.

CREATED:4-4-2023

WATER - DETAIL 32

CITY OF NEWARK, NEW JERSEY

**STANDARD CLEANING WYE FOR WATER DISTRIBUTION PIPE (12" AND SMALLER)**

