


ELEVATION VIEW

NOTE:

1. SUMP PUMP SHALL HAVE BACKUP BATTERY OR BE CONNECTED TO THE BACKUP GENERATOR
2. RPZ TYPE SUCH AS BACKFLOW PREVENTER OR DOUBLE CHECK VALVE DESIGN MUST BE APPROVED BY THE CITY OF NEWARK DEPARTMENT OF WATER AND SEWER BEFORE CONSTRUCTION.

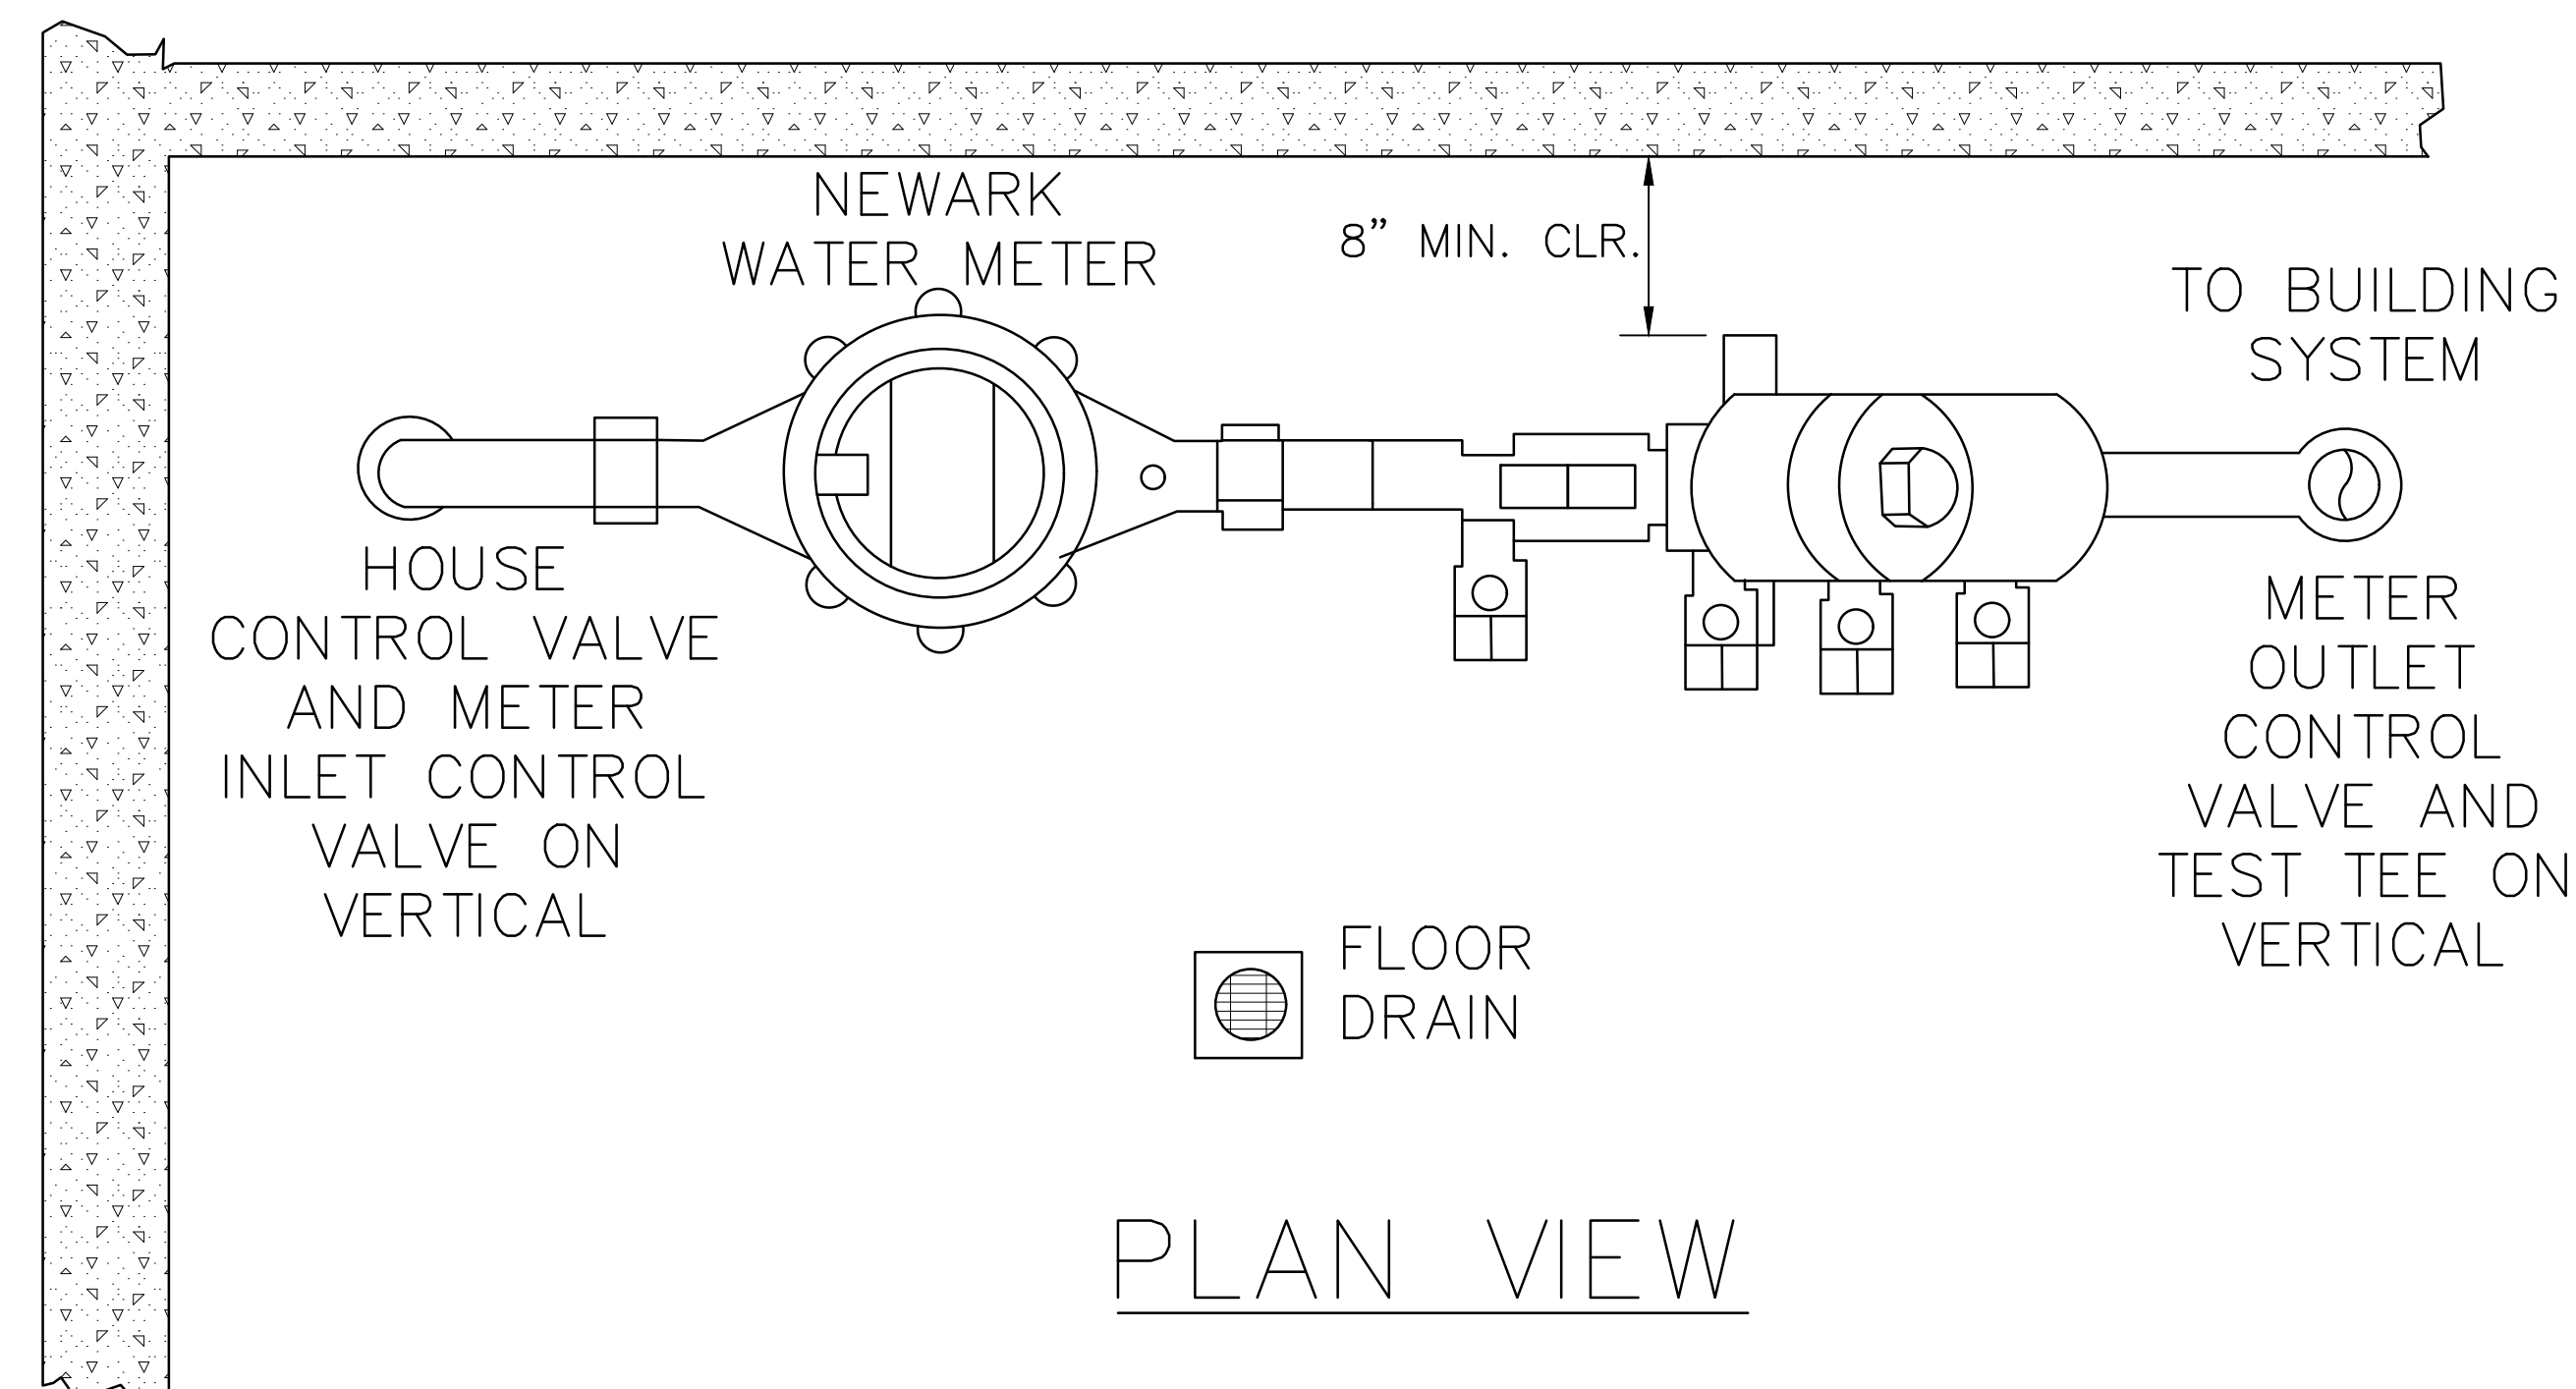

PLAN VIEW

CREATED: 5-23-2023

WATER - DETAIL 43

CITY OF NEWARK, NEW JERSEY
**DOMESTIC WATER SERVICE - FIRST FLOOR
 (DOUBLE CHECK VALVE)**

