




CONTRACTOR SHALL USE THE APPROVED COUPLING SLEEVE.

THE APPROVED EPOXY COATED COUPLING SHALL BE MANUFACTURED BY HYMAX OR APPROVED EQUAL.

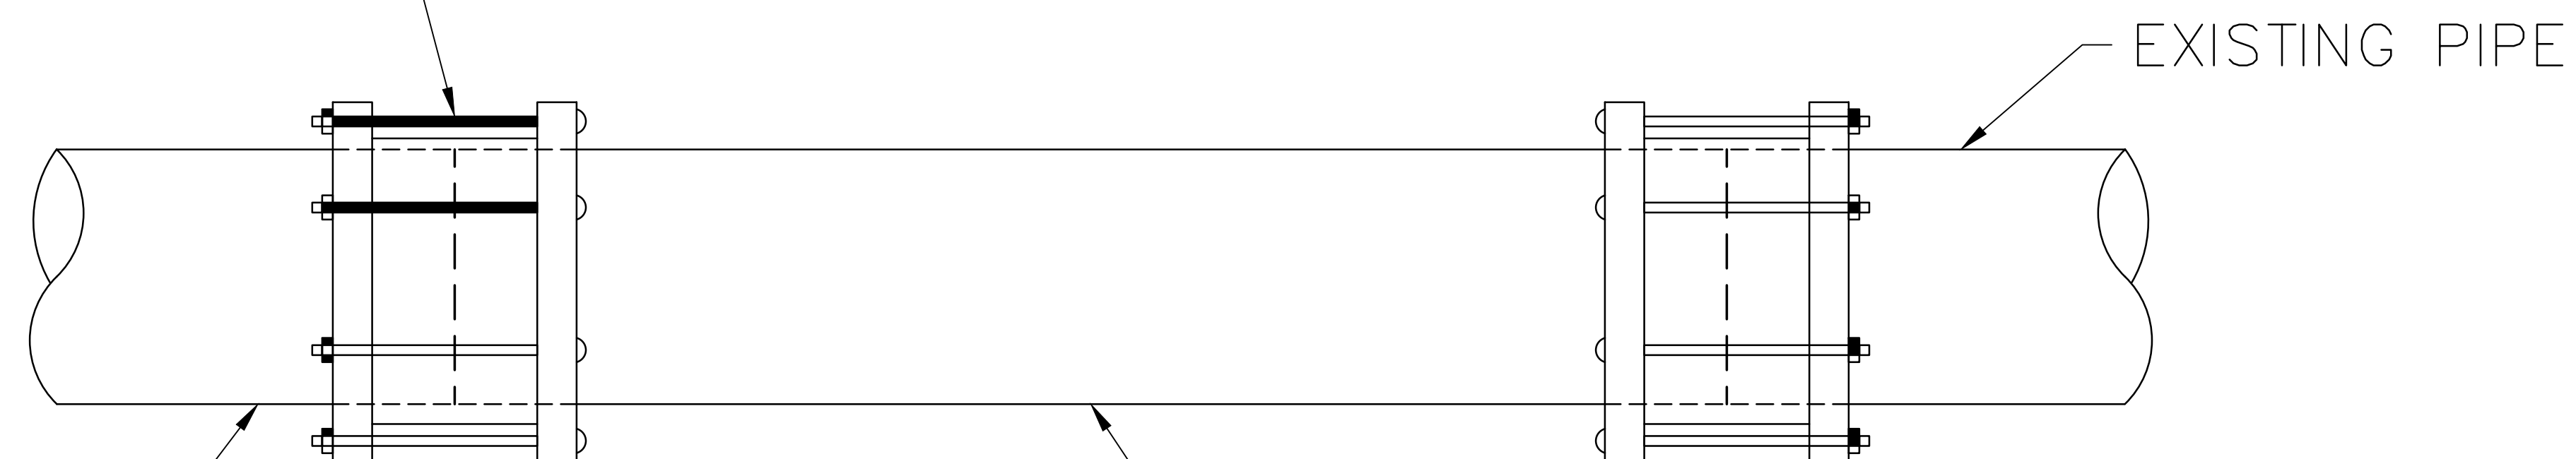

PROPOSED PIPE SHALL MATCH THE OUTER DIAMETER OF THE EXISTING PIPE

REMOVE EXISTING PIPE AND REPLACE WITH NEW PROPOSED PIPE

NOTES:

1. ALL WORK MUST BE PERFORMED BY A LICENSED AND BONDED CONTRACTOR APPROVED BY THE CITY OF NEWARK DEPARTMENT OF WATER AND SEWER (NDW&S).
2. THIS PROCEDURE WILL INVOLVE A MAIN LINE SHUT DOWN THAT THE CONTRACTOR WILL COORDINATE WITH THE CITY OF NEWARK DEPARTMENT OF WATER AND SEWER.
3. WRITTEN NOTIFICATION OF ALL AFFECTED CUSTOMERS MUST BE PERFORMED BY THE CONTRACTOR.
4. ALL WORK MUST BE PERMITTED BY NDW&S AND ALL OTHER APPROPRIATE AGENCIES.
5. ALL WORK MUST BE INSPECTED BY NDW&S INSPECTOR OR DESIGNER.